



PRIMARY ONLY

NOTES:

1. CLEARANCES ARE SPECIFIED TO ACCOMMODATE FUTURE MAINTENANCE OF UNDERGROUND FACILITIES.
2. SELECTED BACKFILL SHALL BE FREE FROM ROCKS OR OTHER MATERIAL WHICH MIGHT DAMAGE CONDUIT.
3. CLEARANCE REQUIREMENTS OF OTHER UTILITIES SHALL GOVERN IF GREATER THAN SPECIFIED.
4. GAS, WATER, AND SEWER PIPING SHALL BE INSTALLED IN SEPARATE TRENCHES FROM ELECTRICAL.

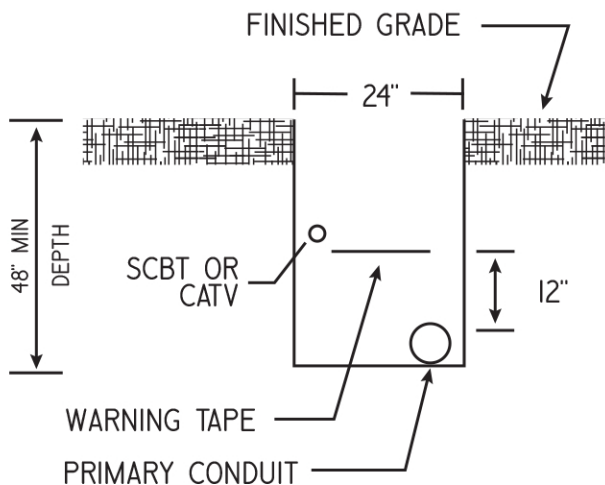

PRIMARY & COMMUNICATIONS

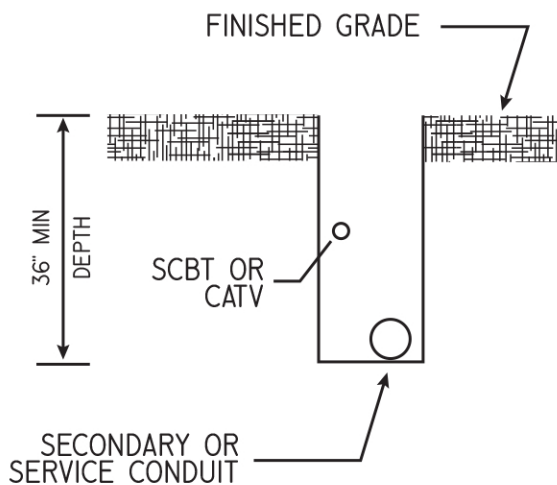

SECONDARY & COMMUNICATIONS



200 N. ROANE STREET
HARRIMAN, TN 37748

TRENCH REQUIREMENTS
RESIDENTIAL INSTALLATIONS

SCALE: NONE